Energy Audit Report of



M/s Institute of Aeronautical Engineering,

Dundigal, Hyderabad, Telangana - 500043

2021-22

Ву



Flat: 401, SS Enclave, 2-1-255, St. No:14, Nallakunta, Hyderabad, M:9848050598

Email:srigayatrienergyservices@gmail.com

Contents

A	CKNOWLEDGEMENT	3
	Disclaimer	4
	Audit Study team	5
	LIST OF INSTRUMENTS USED	5
	CERTIFICATE	6
	Executive Summary of Observations	7
	Detailed Walk Through Energy Audit scope of work	8
	Introduction of the Institution	
	Facility Description	11
	Electrical Load Distribution	12
	Maintenance & Electrical Safety	17
	Annexure -II -Abbreviations &Definitions	
	Annexure :3 HVAC	22
	Annexure - 4 Lighting	23

ACKNOWLEDGEMENT

M/s **Sri Gayatri Energy Services**, Hyderabad places on record its sincere thanks toprogressive management of M/s **Institute of Aeronautical Engineering**, Dundigal, Hyderabad, Telangana for entrusting the Energy Audit work of their College.

The study team is appreciative of the keen interest and encouragement shown by

Sri M Rajasekhar Reddy Chairman

Sri Ch. Sathi Reddy Secretary and Correspondent

Sri **B Rajeshwar Rao** Executive Director & Treasurer

Dr. L V Narasimha Prasad Principal



Disclaimer

Warranties and Liability

While every effort is made to ensure that the content of this report is accurate, the details provided "as is" make no representations or warranties in relation to the accuracy or completeness of the information found on it. While the content of this report is provided in good faith, we do warrant that the information will be kept up to date, be true and not misleading, or that this report will always (or ever) be available for use.

While implementing the recommendations site inspection should be done to constitute professional approach and adequacy of the site to be established without ambiguity and we exclude all representations and warranties relating to the content and use of this report.

In no event We will be liable for any incidental, indirect, consequential or special damages of any kind, or any damages whatsoever, including, without limitation, those resulting from loss of profit, loss of contracts, goodwill, data, information, income, anticipated savings or business relationships, whether or not advised of the possibility of such damage, arising out of or in connection with the use of this report..

Exceptions

Nothing in this disclaimer notice excludes or limits any warranty implied by law for death, fraud, personal injury through negligence, or anything else which it would not be lawful for to exclude.

We trust the data provided by the M/s Institute of Aeronautical Engineering, Dundigal, Hyderabad, Telangana personnel is true to their best of knowledge and we didn't verify the correctness of it.

Audit Study team

Shri D.S.R.Murthy Senior Energy Auditor

Shri N.Goverdhana Chary Engineer

Shri Ashok Engineer

LIST OF INSTRUMENTS USED

- True RMS Power Meter
- Digital Earth Resistance meter (Clamp Type)
- Digital Earth Resistance Meter (Conventional Type , Kyoritsu, Japan)
- Digital Infrared Thermometer (Fluke)

CERTIFICATE

We here by certify that we carried out Energy Audit in the M/s Institute of Aeronautical Engineering, Dundigal, Hyderabad, Telangana during 30,31 July 2021and following Observations were presented below. The Energy Bills were analyzed for energy consumption ,Power factor , Electrical Load distribution , Distribution Losses if any and Recommendation to reduce the same .We appreciate the efforts of the M/s Institute of Aeronautical Engineering, Dundigal, ,Telangana for their Pro Energy Conservation measures in this regard.



Executive Summary of Observations

- 1. A Detailed Walk Through Energy Audit is carried out at the Campus with following observations.
- 2. The Power Factor at the Main Incoming panel (after Transformer) is satisfactory .
- 3. The Power Factor at the individual Blocks in not good, it is recommended to install small PF improvement capacitor banks at the individual Blocks to improve the PF and reduce the losses.
- 4. The Loading of the UPS is observed to be low, where evert they are found to be low, shift the load to the other UPS and switch off the lowly loaded UPS to reduce the losses.
- 5. The Electrical machine load is though its high the diversity is low hence no recommendation for this load.
- 6. It is observed that the CMD is high and average demand recorded in this current academic year is low, it is recommended to keep this in observation and reduce the CMD if it is consistently low.



Detailed Walk Through Energy Audit scope of work

- 1. Physical inspection of the premises with reference to Energy Efficient equipment/ Energy Conservation measures/ Renewable Energy.
- 2. Identifying the Energy saving Opportunities within the premises by installing efficient equipment /devices / system of the electrical installation.
- 3. Identifying the Energy Saving opportunities by adopting continuous suitable monitoring methods

Project Schedule:

1. Walk Through Audit : 1 day



Introduction of the Institution

Institute of Aeronautical Engineering (IARE), Hyderabad was established in the year 2000 and is run by Maruthi Educational Society founded by a devoted group of eminent professional and industrialists having a long and outstanding experience in educational system with a mission 'Education for Liberation'. It is the first institute to start B.Tech program in Aeronautical Engineering in the state of Telangana and has gradually transformed itself into an integrated multi-disciplinary technological institute. It is the most preferred institute with 100% admissions in the state of Telangana.

IARE is a prestigious Autonomous engineering college offering eleven B.Tech programs Computer Science and Engineering, Computer Science and Engineering (Artificial Intelligence and Machine Learning), Computer Science and Engineering (Data Science), Computer Science and Engineering (Cyber Security), Computer Science and Information Technology, Information Technology, Electronics and Communication Engineering, Electrical and Electronics Engineering, Aeronautical Engineering, Mechanical Engineering, Civil Engineering and six M.Tech programs in engineering and MBA (Master of Business Administration) with 21 years of rich standing in the educational sphere. The institute is approved by AICTE, New Delhi; recognized by Govt. of Telangana; permanently affiliated to Jawaharlal Nehru Technological University Hyderabad (JNTUH); and accredited by National Assessment and Accreditation Council (NAAC) with 'A' Grade. All the seven B.Tech programs are accredited thrice by National Board of Accreditation (NBA), New Delhi since 2008. The institute also received UGC recognition under Sections 2(f) and 12(B) of the UGC Act.

The institute is ranked 159 in Engineering category as per National Institutional Ranking Framework (NIRF) – 2021, Ministry of Human Resource Development (MHRD), Govt. of India. This illustrates positive performance and quality standards we maintain in Teaching, Research, Employability, and Innovation. Categorized as 'Band B' institution (rank between 26-50) in category of 'Private or Self-Financed College/Institutes' in Atal Ranking of Institutions on Innovation Achievement (ARIIA) – 2020, as per MHRD's Innovation Cell, Ministry of Education, Govt. of India.

Besides the institute has been ranked by different independent national agencies which include Careers 360 (AAAA), India Today (57), The Week (87), Times of India (79), Competition Success Review (17), Outlook (Rank Band:126-170), DataQuest (59), Business World (60).

The total number of students is 4952 and that of faculty is 292, out of which, 82 are Ph.D's (33%) ensuring healthy faculty student ratio. The research activity on campus is woven in pursuance of its vision & mission statements around the philosophy of Inspire, Innovate, and Implement to benefit the contemporary society. It unwinds itself into different fields such as environment, aerospace, PLC, CAD/CAM, CNC machining, tool design, welding, embedded systems, and low power VLSI digital system design. Emphasis is also being laid on manufacturing, automation, business analytics, big data, cloud computing, wireless technology, image processing, and next generation networks.

IARE has fourteen sponsored research projects, and has received grants of worth Rs. 570.59 lakhs for research and other activities by different agencies including DST, AICTE, UGC etc. The institute has a record of intellectual property with 850+ research paper publications by faculty as well as students and 1705+ citations, 35 patents in last 5 years. Internal Revenue Generation through consultancy facilitates and promotes activities pertaining to energy audit, mobile apps, drones in agriculture, agricultural tools, and material testing.

Big placements greet our students with ample opportunities with around 62 core and software companies visiting the institute every year with 700+ Placements. Placement and training centre is instrumental in

signing the Memorandum of Understanding (MOU) with many reputed organizations including Capgemini, L&T Infotech, TCS, Cognizant, Accenture, Accolite Digital, Wipro, Mindtree, MPhasis, NTT Data, Infosys, Hexaware, Optum, TEK Systems, Atos Syntel, Tata Advanced Systems Limited, Cyient, Virtusa, Temenos and so on...

To promote incubation centres, start-ups and entrepreneurship, IARE signed an MOU with National Research Development Corporation (NRDC) to cooperate for the development of technologies and their successful transfer to industry for commercial and socio economic benefits. The students are provided with avenues to showcase their talents and innovative skills. They also participate in various national level engineering competitions like Baja SAEINDIA, Supra SAEINDIA, Go-kart, ADC championships to name a few and have made their mark by winning prizes and ranks. They participate in national and state level project competitions as well as conferences to share their research findings. Students have represented the institute at international level as well.

The central library houses a rich collection of books for all subjects with recent publications. There are about 76,473 books, 20,665 individual titles, nearly 714 National / International Journals, 2715 back volumes, and e-journals from Elsevier (Science Direct), Springer, ASME, ASCE and IEEE (ASPP). Apart from this, the students have an exclusive access to DELNET for resource sharing. The library is open for 10 hours on weekdays and even on Sundays. Book distribution process has been automated for quick and easy access. For circulation of library books 'Automated Self Service Kiosk' has been installed, which enables users to issue, return and renew books by themselves.

Institute has state of art infrastructural facilities to support teaching-learning, research and administrative services. The institute is spread over 17 acres with built up area of 3,37,500 sft. housing 65+ smart class rooms, 2 ICT studio rooms,4 flipped classrooms, 4 conference halls, auditorium, 8 research laboratories, 103 academic laboratories, science and technology startup park, technology innovation and incubation center, open air amphitheater, makerspace, community facilitation center, skill development center and library. Campus-wide networking with 600 Mbps internet connectivity, Wi-Fi and CCTV facility is available. To reduce the consumption of electricity efficient lightings are used with solar electric energy of 160 KW on the grid. A captive power of 480 KVA is provided to ensure smooth working of the institute in times of power outage. The institute operates 32 buses for the benefit of students and staff.

IARE has a home away from home with the best amenities for the students to provide them a comfortable lifestyle within a vicinity of 1 km of the campus. The institute provides separate hostels for boys and girls, made to grow as places to support learning not only academics but also life skills in a multi-cultural and multi-lingual environment.

Students are encouraged to participate as actively in sports and other extracurricular activities as in academics. The institute maintains a separate unoccupied open area of 4 acres for the play fields in any time fit condition. Apart from this, the institute also has several sports rooms where students can play and revive their energies and be mentally and physically fit.

The IARE also enjoys geographical advantage, as it is well connected by air, rail and road. The college campus is adjacent to Nehru Outer Ring Road close to Dundigal junction exit-5, making it accessible to several important centers in and around the city. The Campus is situated 20 Km away from Secunderabad railway station and 11 Km from JNTUH University, Kukatpally, in a lush green and pollution free environment.

With its belief in holistic approach to excellence, the institute offers distinct Teaching-Learning Process to push the boundaries of human knowledge. The Institute excels in supporting "Research initiatives among students and faculty members" and "Entrepreneurship drive among students" which makes IARE as one of the best institutions to enhance the performance of the students.

Facility Description

The Facility Receives Power supply from TSSPDCL at 11 KV, the installed transformer is 11 KV/433 V transformer of 315 KVA and the Contracted Maximum Demand with TSSPDCL is 200 KVA, The total connected Load is around 1276 KW.

At present due to Covid 19 Lock downs the Demand is not reaching close to the 80 % value of the CMD.


Hence it is recommended to reduce the same.

There are Three Blocks in the campus as Bhardwaja Blcok, AryaBhatta Block, Abdul Kalam Block, Workshops, Sheds, The Electric machines, UPS, Computer Systems are located in these three Blocks.

Electrical Load Distribution

The Incoming power supply is from a 11 KV TSSPDCL ,with one Transformers of rating 11kV/433~V~315~KVA, The total connected load is around 1276 KW . The emergency supply. taken care by DG Sets . All the three Blocks are equipped with UPS supply for Power back up for the computer systems. The details of the connected Load across the campus is given below

Connected Load,KW				
Lighting	136.94			
AC's	407.1			
TV/Cameras	18.25			
Electric Machine Load	271.3			
Air Cooled Motors	38			
Lifts	5.5			
Fire Pump Motors	16.5			
Computer systems	382.5			
Total	1276.09			

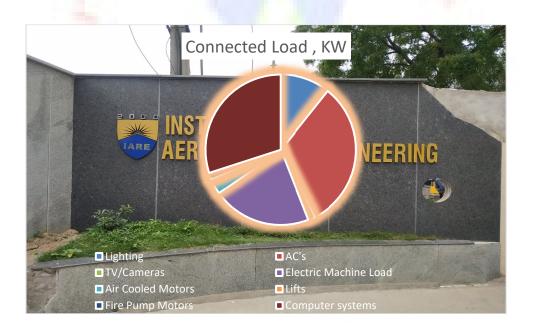

The Load distribution Block Wise

Name of the block	Name of the load	Total capacity (in watts)
Bharadwaj block	Drinking Water cooler, 1 (50w*5no)	0.25KW
·	Fire motors,3ø (7.5hp*2no)	11kw
	Electrical Machine's load	110KW
Abdul kalam block	Air cooled motors (7.5HP*4no)	22kw
	Fire motors,3ø (7.5hp*1no)	5.5kW
	Electrical Machine's load	35.3KW
Aryabhata block	Drinking Water cooler (50w*5no)	0.25KW
	Lift-3ø (7.5hp*1no)	5.5KW
	Electrical Machine's load (in all sheds)	126KW
sheds	Drinking Water cooler (50w*5no)	0.25KW
- L	Air cooled motors (7.5HP*3no)	16kw

The UPS Installed across the campus is Total 44 No's and capacity total to 500 KVA.

The Power Measurements are carried out

Powe	er M	leasurements	of Electrical	Paramet	ers		
						wer	Remarks
Location		Voltage	Current	PF	KW	KVA	
Main Incomer	R	234	155.5	0.95	34.55	36	
	Υ	241	162.9	0.98	39.17	39.3	
	В		No	Load			
Bhardwaja Block	R	234.2	78.5	0.92	17.1	18.4	
Panel 01	Υ	238.1	6 <mark>6.1</mark>	0.94	14.96	15.8	
	В	238.2	55.1	0.9	11.73	13.07	
		F 33.4		1			
Bhardwaja Block	R	234.2	0	0.92	17.1	18.4	No Load
Panel 02	Υ	238.1	0	0.94	14.96	15.8	No Load
	В	238.2	0	0.9	11.73	13.07	No Load
794							
UPS-01 , 20 KVA Input	R	239.3	7.7	0.8	3.38	4.21	
1	Υ		No	Load			
And and an artist of the second	В	239.3	17.5	0.79	3.31	4.1	
UPS-02 , 20 KVA Input	R	230.7	1.8	0.29	0.12	0.42	
99	Υ	244.2	1.9	0.13	0.06	0.47	
100	В	No Load				-	
186							
UPS-03 , 20 KVA Input	R						
- Torr	Υ						
	В						
UPS-02 , 20 KVA Input	R	No Load					
	Υ		No	Load			
	В						
UPS-05 , 15 KVA Input	R	239.3	1.7	0.32	0.13	0.42	
	Υ	242.6	1.6	0.25	0.1	0.41	
	В	246.5	1.4	0.29	0.1	0.36	
Arya Bhatta Block	R	236	29.2	0.97	6.73	6.92	
Panel 01	Υ	238.1	13.8	0.84	2.63	3.12	
	В	237.4	35.8	0.93	8.07	8.61	

Arya Bhatta Block	R	234.2	3.6	0.13	0.11	0.88	
UPS -09	Υ	25 1.2	No Load				
20 KVA	В	237.4	3.3	0.47	0.47	0.88	
20 1111		20711	- 3.3	0.17	0117	0.00	<u>. </u>
Arya Bhatta Block	R	234.8	2.2	0.627	0.34	0.54	
UPS -10	Υ	238.4	2	0.37	0.18	0.5	<u> </u>
20 KVA	В	237.4	3	0.61	0.48	0.75	
Arya Bhatta Block	R	241.1	2.1	0.28	0.15	0.53	
UPS -06	Υ	235.4	1.9	0.49	0.24	0.48	
20 KVA	В		No	Load			
		~ 0.7 V	5.0				
Abdul Kalam Block	R	235.1	22.9	0.98	5.34	5.9	
Panel 01	Υ	241.1	6.8	0.97	1.63	1.67	
2.7	В	239	15.7	0.67	2.43	3.59	
Abdul Kalam Block	R	237	3.5	0.58	0.31	0.83	
UPS-07	Υ	238.3	2.9	0.22	0.31	0.55	
20 KVA	В	242.8	1.8	0.37	0.16	0.42	
Professional Contract of the C							
Abdul Kalam Block	R	234.5	8.4	0.97	1.97	2.02	
UPS-08	Υ	233.4	7.9	0.88	1.24	1.41	
20 KVA	В	239.9	9.2	0.96	2.11	2.19	
70							
Lab shed Block	R	235.7	3.4	0.83	0.68	0.81	
	Υ		No Load				
-	В	238.6	1.9	0.75	0.36	0.48	
-				_			
	3		· p	100			

The Energy Bills Analysis is carried out to Understanding the Consumption pattern of the Institute

M/s Institute of Aeronautical Engineering , Dindigul, Medak Distt, Telangana											
Month	KWH	KVAH	PF	Actual KVA	Billed KVA	TOD1	TOD2	Demand	Energy	TOD	Total
JAN20	25133	25204	0.99718	166.8	160	3287	4286	65052	180835.2	7573	254851.2
FEB20	28883	28973	0.99692	167.68	160	3112	4574	65395.2	220615.2	7686	295393.4
MAR20	30845	30955	0.99644	219.28	160	3208	4450	78000	226215.6	7658	328652
APR20	12742	13097	0.97289	45.2	160	1188	3535	62400	41854.8	4733	109309
MAY20	11728	12169	0.96376	49.2	160	1079	3400	62400	32237	4479	9936438
JUN20	13488	14005	0.963084	67.04	160	1476	3631	62400	69084.6	5107	137123
JUL20	12341	12659	0.97487	53.92	160	1114	3288	62400	67009	4402	134327
AUG20	15160	15577	0.97322	58.64	160	1500	3507	62400	89895	5007	157993.5
SEP20	17191	17880	0.961465	110.88	70	2156	3530	27300	13841.68	6538.9	202475.6
OCT20	14976	15588	0.960739	110.88	160	1690	2999	62400	105768	4689	173670.6
NOV20	14429	14854	0.971388	69.44	160	1109	3468	62400	80449.2	4577	148045
DEC20	13212	13618	0.970186	57.52	160	1235	3118	62400	77110.8	4353	144456
JAN21	13640	14051	0.97018	70.88	160	1566	3224	62400	77836.2	4790	145624
FEB 21	17298	17867	0.96815	101.2	160	1956	3951	62400	125697	5907	194970
MAR21	24273	25733	0.95869	163.2	160	2291	3771	63648	189329	6062	260496
APR21	22459	23748	0.94572	99.44	160	2148	4245	62400	167138	6393	237217
MAY 21	15801	16800	0.94053	105.36	160	1446	3414	62400	106548	4860	174627
JUN 21	11284	11648	0.96875	105.36	160	884	2856	62400	66268	3740	132919

Saving Opportunities

- 1. The Actual Demand is observed to be recorded less than the CMD, it is recommended to reduce the CMD to 130 KVA from 200 KVA and there by savings of Rs 11700/- per month on account of Demand Charges.
- 2. The Individual Blockwise Power Factor to be improved to reduce the losses .
- 3. The UPS Loading to be improved OR shift the low loaded UPS load to other UPS .



1. Elctrical Single Line Diagram / Lay Out Diagram / Equipment Layout / Electrical Control diagram

- i. Check for Unauthorized Temporary Installations
- ii. Modification to be Updated
- iii. SLD reflects the actual installation
- iv. Duly approved by statutory authorities

2. Importance of Electrical Safety in the Overall Safety System

Periodicity of comprehensive Electrical Safety check

- i. Understanding of electrical hazards
- ii. Electrical checkpoints in the safety checklist
- iii. Implementation priority for electrical hazards
- iv. Electrical Work Permit System
- v. Safe Electrical Operating Procedures

3 Electrical Preventive Maintenance

- i. Is there an Electrical Preventive Maintenance programme in place
- ii. Is the programme implemented? What is the slippage?
- iii. Are the relevant standards (statutes and non-statutory) referred and incorporated in the EPM programme?
- iv. Electrical Tests, Rec<mark>ords, Test Procedure and periodicity (earth resistance, insulation resistance tests)</mark>
- v. Is the EPM programme only documented?
- vi. Transformer tests (dielectric strength, acidity, sludge deposits, dissolved gases, etc.) and periodicity
- vii. Periodic calibration of meters (ammeter, voltmeter, relays, temperature gauges) and test instruments (insulation resistance megger, earth resistance megger, multi-meters, etc.)

4 Earthing System

- i. Installation as per approved design?
- ii. Installation and Maintenance as per IS 3043?
- iii. Earth resistance measured periodically?
- iv. Test procedure
- v. Acceptable earth resistance values
- vi. Is the earthing system modified when electrical installation is modified?
- vii. Are neutral earth pits independent and separate?
- viii. Are earth pits identified?
- ix. Are two and distinct earth connections provided?
- x. Is the earth continuity tested?
- xi. Is bonding and earthing carried out to avoid ESD hazards?

<u>Annexure I</u>

Conversion factors

CONVERSION TABLES

1 Kcal	3.9685 Btu
1 KWh	3413 Btu
1 KWh	860 kcal
1 Btu	1.055 kJ
1 calorie	4.186 joules
1 hp	746 Watts
1 kg	2.2 lb (pounds)
1 meters	3.28 feet
1 inch	2.54 cm
1 kg/cm ²	14.22 psi
1 atmosphere	1.0332 kg/cm ²
1 kg/cm ²	10 meters of water column @ 4 ºC
1 kg/cm ²	9.807 × 10 4 passels
1 Ton of Refrigeration	3023 kcal/hour
1 Ton of Refrigeration	12000 Btu/hour
1 US Gallon	3.785 liters
1 imperial Gallon	4.546 liters
ºF	1.8 × ^o C + 32
ºk	ºc + 273

Annexure -II -Abbreviations &Definitions

Abbreviations

°C degrees Celsius

°F degrees Fahrenheit

Btu British thermal unit

Btu/ft2 British thermal units per square foot

J/m² Joules per square meter

kVA kilovolt-amperes

kW kilowatts

kWh kilowatt-hours

kWh/m² kilowatt-hours per square meter

Definitions:

Basic definitions of terms

Absorber. The component of the vapour absorption chilling package wherein the refrigerant vapour is absorbed by the liquid absorbent.

Air Handling Unit. An air cooling unit, consisting of a blower or blowers, heat exchanger and filters with refrigerant, chilled water or brine on the tube side to perform one or more of the functions of circulating, cooling, cleaning, humidifying, dehumidifying and mixing of air.

Brine. Solution of anti-freeze substances like Sodium Chloride, Calcium Chloride, Mono-ethylene Glycol, Ethyl Alcohol etc.

Coefficient of Performance. The ratio of Net Refrigerating Effect divided by Compressor Shaft Power or Thermal Power Input. The numerator and denominator should be in the same measuring units.

Compressors. Machines in which compression of refrigerant vapour is effected by the positive action of linear motion of pistons, rotating elements (screws, vanes, scrolls etc.) or conversion of velocity energy to pressure in a centrifugal device.

Compressor, hermetic. Sealed compressor & motor unit, where the electric motor is cooled by the refrigerant and both the compressor and electric motor are not accessible for maintenance.

Compressor, open. Compressor is externally coupled to the prime mover and the refrigerant does not cool the prime mover.

Compressor, semi-hermetic. Compressor motor unit, where the electric motor is cooled by the refrigerant and the compressor is accessible for maintenance.

Condenser. The heat exchanger, which utilizes refrigerant to water/air heat transfer, causing the refrigerant to condense and the water/air to be heated. De-superheating or sub-cooling of the refrigerant may also occur.

Energy Efficiency Ratio. The ratio of Net Refrigerating Effect (Btu/hr) divided by Shaft Power (Watts) or Thermal Power Input (Watts) consumed.

Electric Motor. Electrically operated rotary prime mover.

Enthalpy. The heat content of a substance at a particular temperature.

Engine. Internal combustion engine used as prime mover.

Evaporator. The heat exchanger wherein the refrigerant evaporates and, in the process, cools another fluid I(generally water, brine or air).

Fluid. The substance that is usefully cooled in the chilling package (generally water, brine or air).

Generator. The component of a vapor absorption chilling package wherein the absorbent solution is heated to evaporate the refrigerant and concentrate the absorbent.

Gross Calorific Value. The amount of heat produced per unit of fuel when complete combustion takes place at constant pressure, the products of combustion are cooled to the initial temperature of the fuel and air, and the vapor formed during combustion is condensed.

Net Refrigeration Effect. The useful cooling effect (or heat removal) in the evaporator.

Psychometric Chart. A chart or plotted curves showing the various parameters of air at different temperatures at atmospheric pressure. The parameters shown include dry bulb temperature, wet bulb temperature, relative humidity, moisture content, enthalpy and sensible heat factor.

Refrigerant. The substance that evaporates in the evaporator to provide cooling effect.

Shaft Power. Power at the shaft of any rotary equipment.

Specific Fuel Consumption. The ratio of Thermal Power Input (kg/h of liquid fuel or m3/h of gaseous fuel consumed to the Net Refrigerating Effect (Tons of Refrigeration).

Specific humidity. Mass of water vapor per unit mass of dry air.

Specific Power Consumption. The ratio of Shaft Power (kW) to the Net Refrigerating Effect (Tons of Refrigeration).

Specific Steam Consumption. The ratio of Thermal Power Input (kg/h of steam) to the Net Refrigerating Effect (Tons of Refrigeration).

Speed. The number of revolutions per minute of the shaft.

Temperature, dry bulb. The temperature indicated by any temperature sensing element when held in air.


Temperature, Inlet. Temperature measured at the inlet stream of the heat exchanger.

Temperature, Outlet. Temperature measured at the outlet stream of the heat exchanger

Annexure: 3 HVAC

Introduction & back ground

Refrigeration Basics

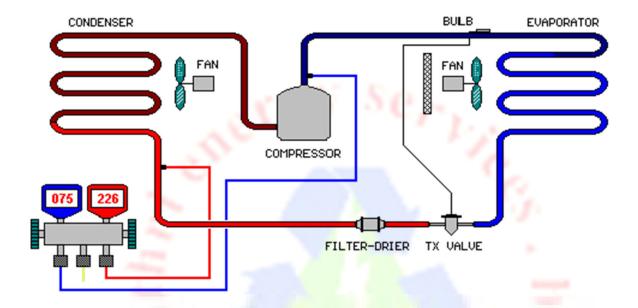

- Refrigeration is the removal of heat from a material or space, so that it's temperature is lower than that of its surroundings.
- When refrigerant absorbs the unwanted heat, this raises the refrigerant's temperature ("Saturation Temperature") so that it changes from a liquid to a gas it evaporates. The system then uses condensation to release the heat and change the refrigerant back into a liquid. This is called "Latent Heat".
- This cycle is based on the physical principle, that a liquid extracts heat from the surrounding area as it expands (boils) into a gas.
- To accomplish this, the refrigerant is pumped through a closed looped pipe system.
- The closed looped pipe system stops the refrigerant from becoming contaminated and controls its stream. The refrigerant will be both a vapor and a liquid in the loop.

Annexure - 4 Lighting

Recommended illumination Levels as Per IS 3646 Part I-1992						
	Range of		Remarks			
	Service	Quality Class of				
	Illuminanace	Direct Glare				
Type of Interior Activity	in Lux	Limitation				
Educ	ation					
Assembly Halls	200-300-500	3				
Teaching Spaces	200-300-500	1				
Lecture Theatres						
i) General	200-300-500	1				
	. 1 14.3	307	Localized Lighting may be			
ii) Demo Benches	300-500-700	1	appropriate			
iii) Seminar Rooms	300-500-750	1	12			
iv) Art Rooms	300-500-750	1	(<u>"</u>			
v) laboratories	300-500-750	1	64.			
vi) Libraries	200-300-500	1	UP.			
vii)Music Rooms	200-300-500	1				
viii) Sports Hall	200-300-500	1	+			
ix) Work Shop	200-300- <mark>500</mark>	1				
x)Computer Work station	300-500-750	1				
xi)Bath Rooms	50-100-150		Supplementary local lighting near mirror			
xii) Office Rooms	300-500-750	1				
xiii) Entrance Halls, Lobbies	150-200-300	2				
xiv) Corridors, Passageway, Stairs	50-100-150	2				
_			424			

<u>Light Source Comparison</u>					
<u>Attributes</u>	Incandescent	<u>CFL</u>	<u>LED</u>		
Colur Rendering Index	100	Greater than 80	40-80		
Watts/ Lamp	100	23	1		
Lumen/Lamp	1600	1600	30		
Lumen/Watt	16	60-80	20-30		
Life (Hrs)	750	8000	50,000		

Colour Rendering Index

colour Kendering index
Candlelight
40 W incandescent lamp
200 W incandescent lamp
Sunrise/sunset
Tungsten lamp
1 hour from dusk/dawn
Xenon lamp/light arc
Sunny daylight around noon
Electronic photo flash
Overcast sky
Blue sky
· practe